


NetworkThermostat Controller Interface

Installation and Wiring for Home-Run (Star) Configuration

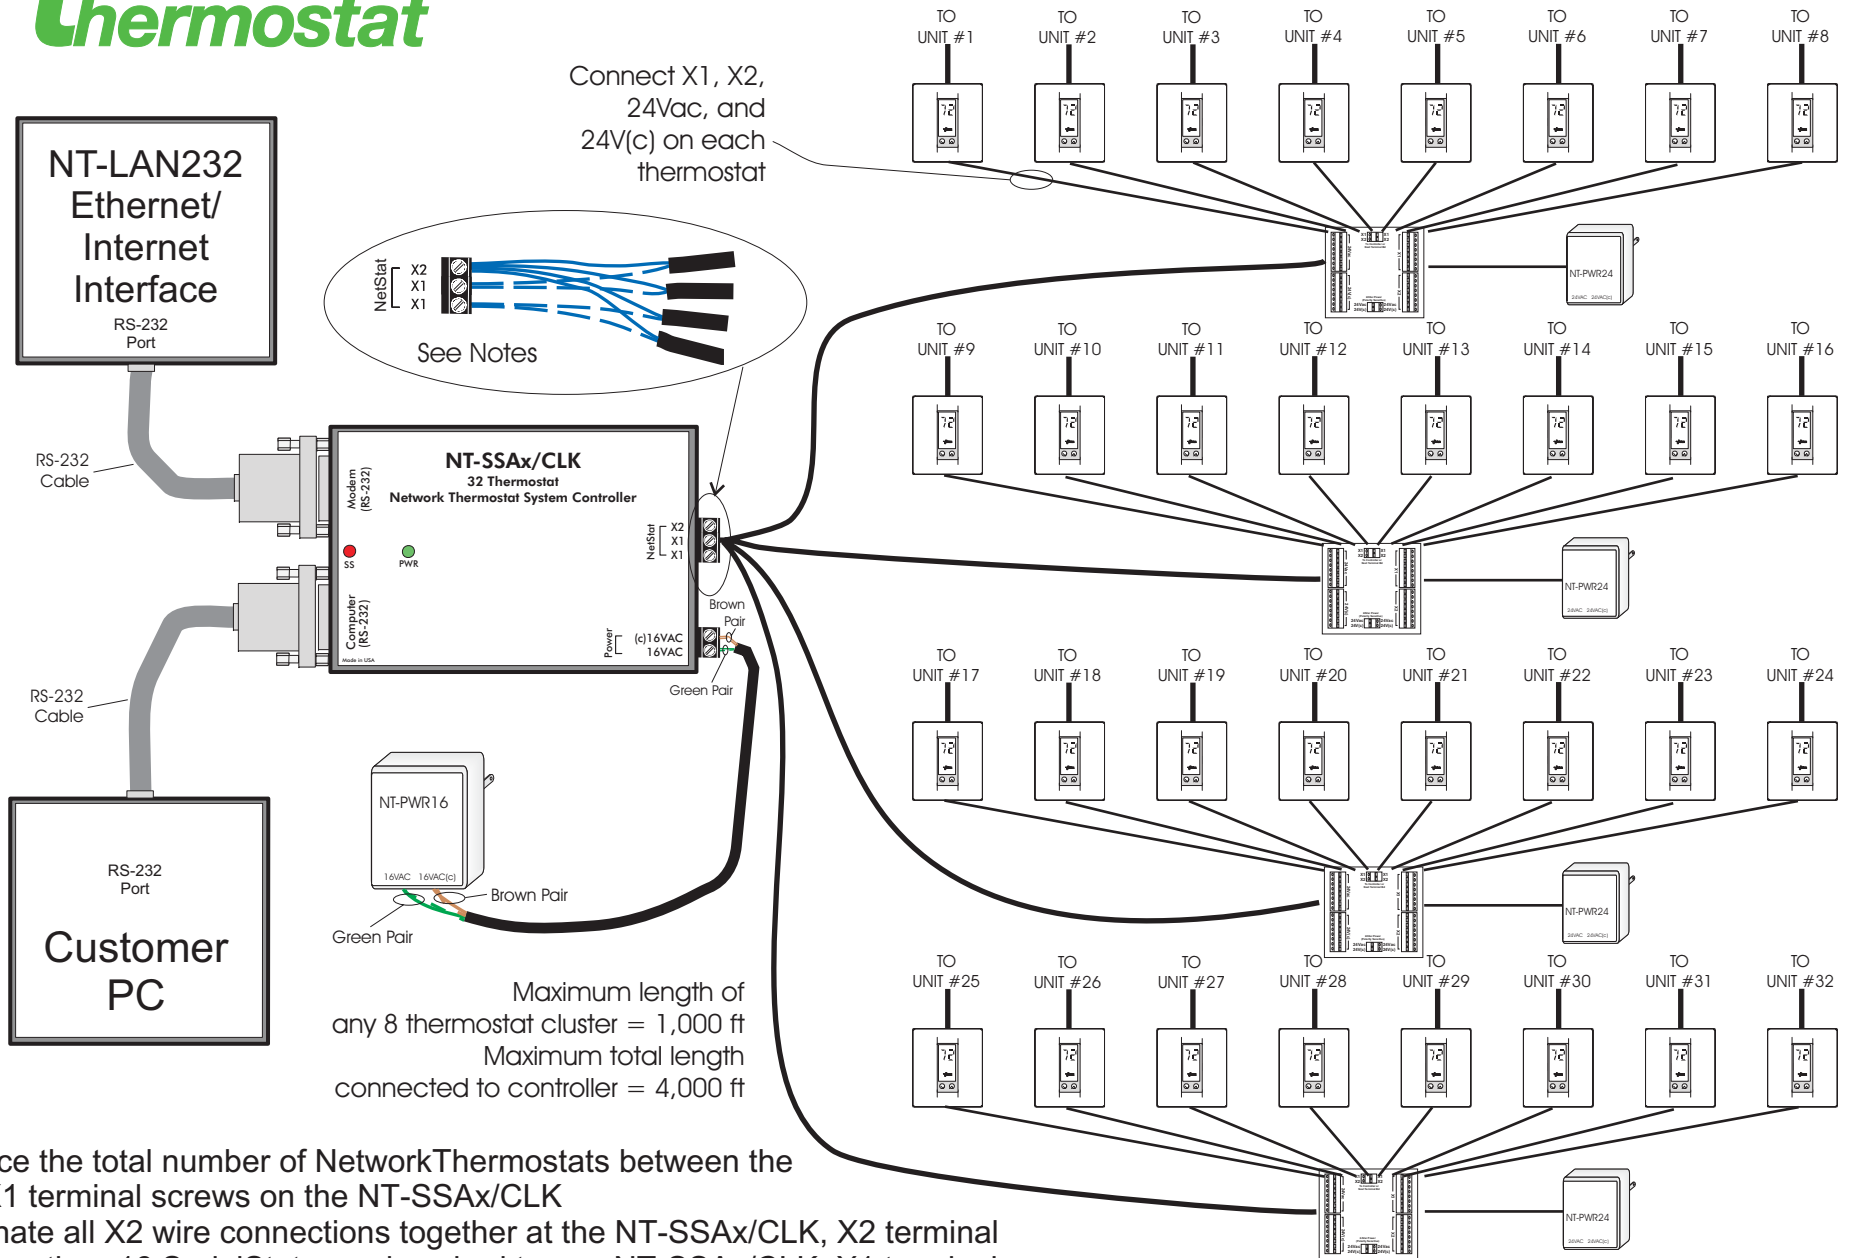

NOTES:

- 1) Balance the total number of NetworkThermostats between the two X1 terminal screws on the NT-SSAx/CLK
- 2) Terminate all X2 wire connections together at the NT-SSAx/CLK, X2 terminal
- 3) No more than 16 SerialStats can be wired to one NT-SSAx/CLK, X1 terminal
- 4) No more than 8 NetworkThermostats can be wired to one Home-Run section
- 5) Use a similar quantity of NetworkThermostats on each Home-Run section

NetworkThermostats
Dallas, TX

Tech Support: 866-563-0711

www.networkthermostat.com